COUNTY SANITATION DISTRICT NO. 2-3

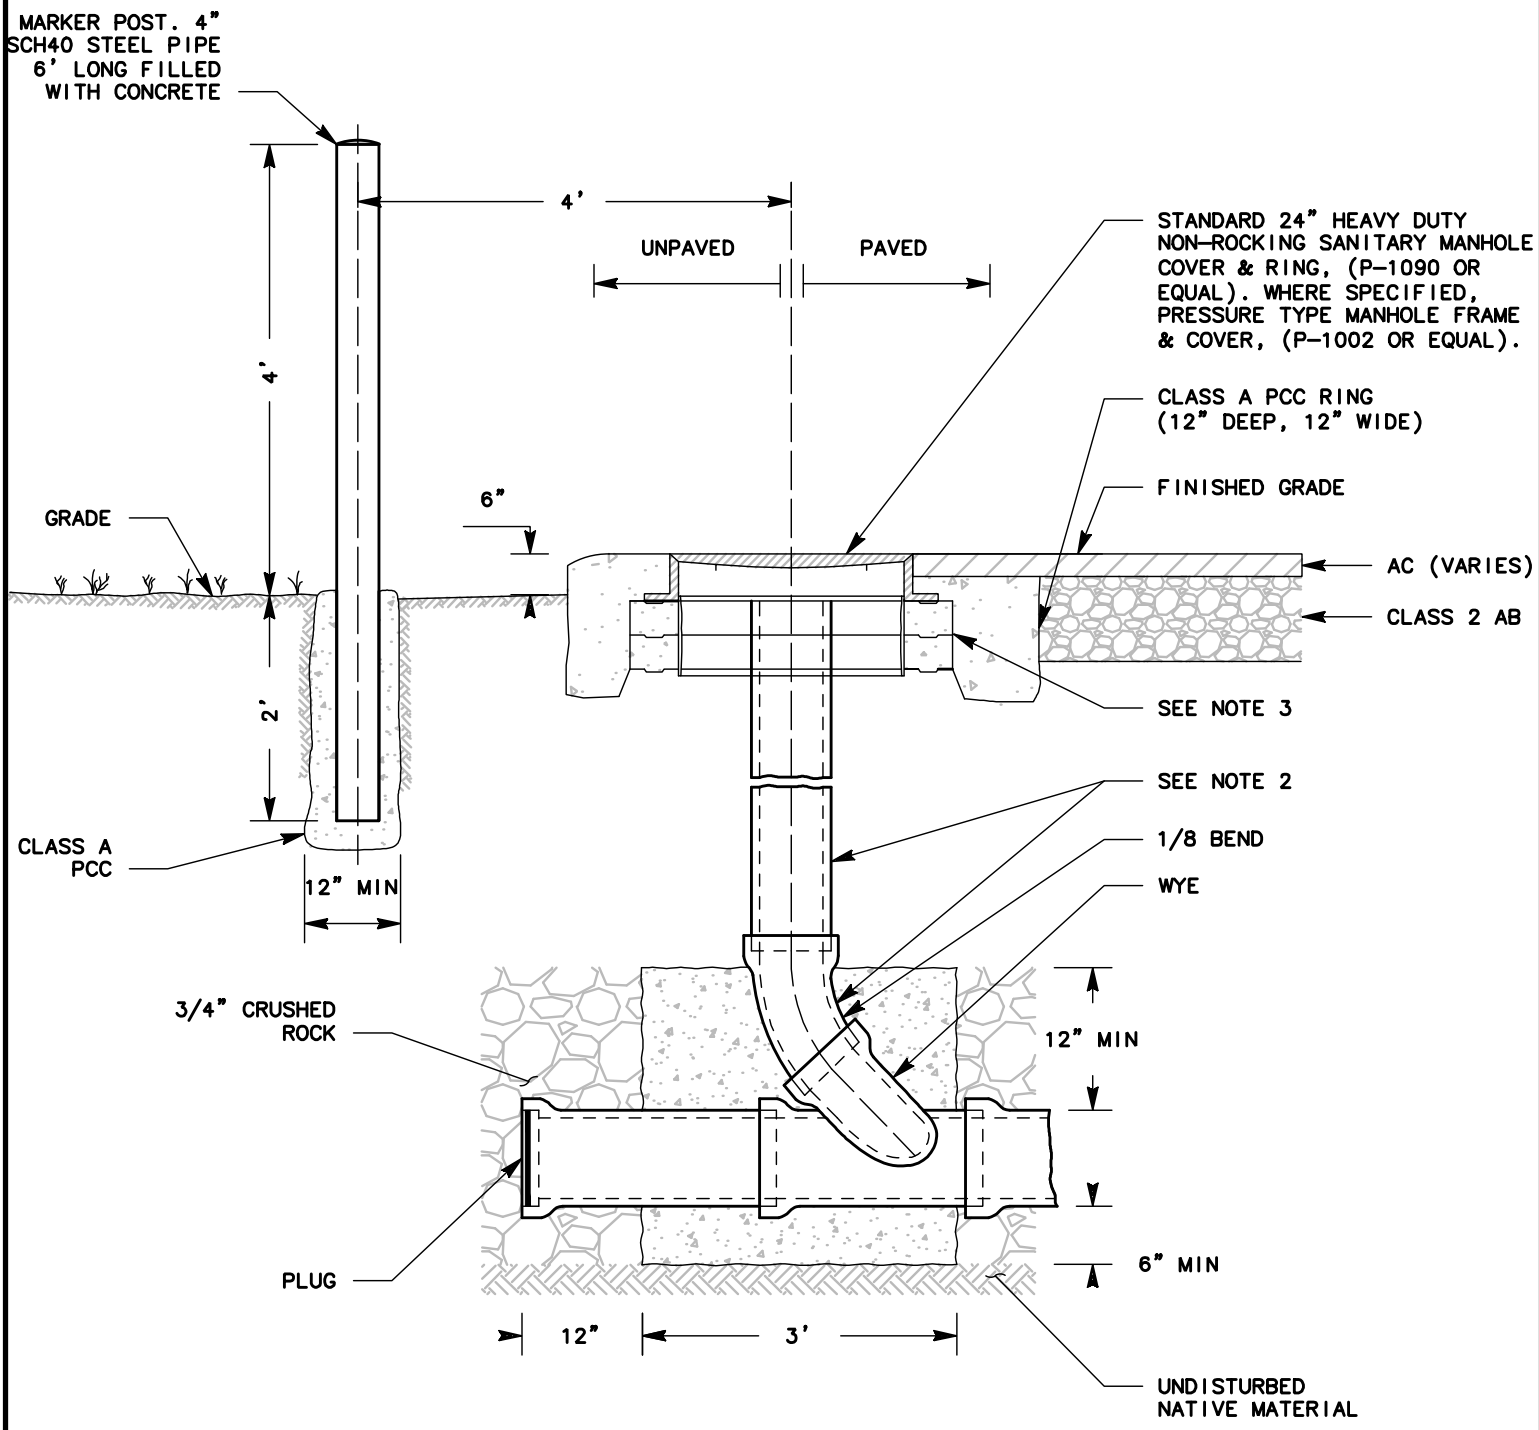

NOTES:

1. SEE CITY/COUNTY TRENCH DETAIL FOR BACKFILL REQUIREMENTS AND SEE DISTRICTS STANDARD TRENCH DETAIL FOR MINIMUM BACKFILL REQUIREMENTS.
2. RISER & 1/8 BEND TO BE SAME SIZE AS EXISTING MAIN. PVC SDR26, OR APPROVED EQUAL. PRIOR WRITTEN APPROVAL BY DISTRICT ENGINEER REQUIRED FOR ALL SUBSTITUTIONS OF MATERIALS OR CONFIGURATION.
3. 3" ADJUSTING RINGS. MAXIMUM 2, UNLESS OTHERWISE DIRECTED BY DISTRICT ENGINEER.

FLUSHING INLET

DETAIL **5**

DR. BY:	DATE:	CK. BY:	DATE:	APPROVED. BY:	DATE:
ED	08/30/2017	FQ	10/20/2017		10/25/2017