




COUNTY SANITATION DISTRICT NO. 2-3

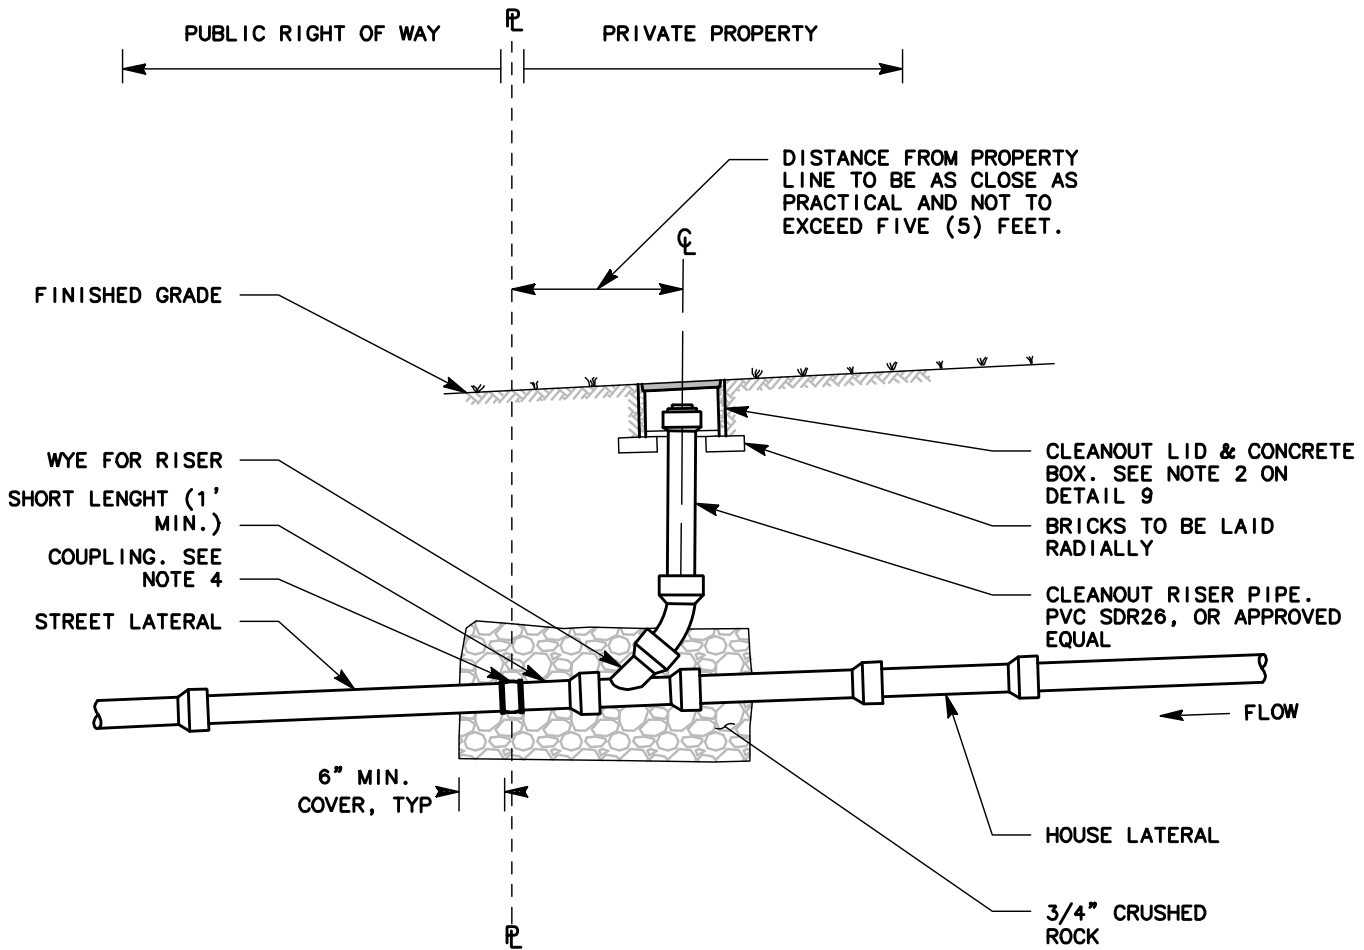

NOTES:

1. DETAIL TO BE USED ON NEW SANITARY SEWER LATERAL INSTALLATIONS. FOR NEW CLEANOUT INSTALLATION ON EXISTING LATERALS, SEE DETAIL 9.
2. 2% MINIMUM PIPE SLOPE, TYP.
3. LATERAL SEWER CLEANOUT TO BE SAME SIZE AS SEWER LATERAL.
4. AT LEAST 6" CLEARANCE BETWEEN VALVE CAP AND INSIDE OF BOX.
5. CONNECT HOUSE/PRIVATE LATERAL TO EXISTING STREET LATERAL WITH MISSION CLAY "SHEAR RING", OR FERNCO "ARC SHIELDED" COUPLING, OR APPROVED EQUAL.
6. INSPECTION INFORMATION
 - 6.1. CONTACT DISTRICT OFFICE FOR LATERAL/CLEANOUT LOCATION AT (408)253-7071
 - 6.2. NOTIFY DISTRICT INSPECTOR 48 HOURS PRIOR TO CONSTRUCTION
 - 6.3. CONTACT DISTRICT INSPECTOR FOR VISUAL INSPECTION PRIOR TO BACKFILLING FOR FINAL APPROVAL
 - 6.4. FINAL INSPECTION CONSISTS OF CLOSED CIRCUIT VIDEO INSPECTION OF POINT OF CONNECTION AND LOWER LATERAL TO CONFIRM DEBRIS HAS NOT ENTERED SEWER SYSTEM

PROPERTY LINE CLEANOUT ON NEW LATERAL

DETAIL **7**

DR. BY: ED
DATE: 08/30/2017

CK. BY: FQ
DATE: 10/20/2017

APPROVED. BY:

DATE: 10/25/2017